

NOTES

1. The drawing is protected under the copyright Act and cannot be used or reproduced in part or in whole withought authors consent.
2. All dimensions are to be checked on site and cannot be written on dimension rules over scaled dimensions.
3. P. V denotes permant ventilation and must be provided above all fenestrations. and indicated on plans;
   - f.g.l - denotes finished ground Level
   - p.v.c - denotes poly vinyl chloride
   - m.h - denotes man hole
   - w.h.b - denotes wash hand basin
   - s.v.p - denotes soil vent pipe
   - w.c - denotes water closet
   - g.t. - denotes gulley trap
   - f.t - denotes floor trap
   - sh. - denotes shower
4. D. P. C denotes damp proof course, one layer of bituminous felt and must be provided on all bearing walls.
5. All walls must be reinforced with hoop iron at every alternate course.
6. Plinth level to a minimum of 300mm from ground level.
7. Depth of foundation trenches to be a minimum of 600mm below the reduced level.
8. All dimensions are in mm (millimeters) unless otherwise stated.
9. All reinforced concrete (R. C) works and trusses should the to Structural Engineers specs.
10. All sanitary and sewarage works to comply with the Public Health regulations.
11. All burried drainage pipes should be of class "41" golden brownKey Terrain U. P. V. C.
12. Drainage pipes passing under the building should be encased in 150mm thick concrete surrounding.

CONSULTANTS

PROJECT	*PROPOSED MODERN OFFICE COMPLEX*		
CLIENT	*COUNTY COMMISSIONERS OFFICE AT ITEN EMC FOR MINISTRY OF INTERIOR P. O. BOX ..... - 30100 ELDORET.*		
ITEM(S)	Ground Floor Plan		
A. A	Malachi W.	Date	October, 2026
R. A	Eng. K. Limo	Scale	1:75
R. W. O	Eng. K. Limo	Checked	
DRG No.			

MINISTRY OF LANDS, PUBLIC WORKS, HOUSING AND URBAN DEVELOPMENT

STATE DEPARTMENT FOR PUBLIC WORKS CENTRAL RIFT REGION

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA



NOTES

1. The drawing is protected under the copyright Act and cannot be used or reproduced in part or in whole withought authors consent.
2. All dimensions are to be checked on site and cannot be written on dimension rules over scaled dimensions.
3. P. V denotes permant ventilation and must be provided above all fenestrations. and indicated on plans;
   - f.g.l - denotes finished ground Level
   - p.v.c - denotes poly vinyl chloride
   - m.h - denotes man hole
   - w.h.b - denotes wash hand basin
   - s.v.p - denotes soil vent pipe
   - w.c - denotes water closet
   - g.t. - denotes gulley trap
   - f.t - denotes floor trap
   - sh. - denotes shower
4. D. P. C denotes damp proof course, one layer of bituminous felt and must be provided on all bearing walls.
5. All walls must be reinforced with hoop iron at every alternate course.
6. Plinth level to a minimum of 300mm from ground level.
7. Depth of foundation trenches to be a minimum of 600mm below the reduced level.
8. All dimensions are in mm (millimeters) unless otherwise stated.
9. All reinforced concrete (R. C) works and trusses should the to Structural Engineers specs.
10. All sanitary and sewarage works to comply with the Public Health regulations.
11. All burried drainage pipes should be of class "41" golden brownKey Terrain U. P. V. C.
12. Drainage pipes passing under the building should be encased in 150mm thick concrete surrounding.

CONSULTANTS

PROJECT	*PROPOSED MODERN OFFICE COMPLEX*		
CLIENT	*COUNTY COMMISSIONERS OFFICE AT ITEN EHC FOR MINISTRY OF INTERIOR P. O. BOX ..... - 30100 ELDORET.*		
ITEM(S)	First Floor Plan		
A. A	Malachi W.	Date	October, 2026
R. A	Eng. K. Limo	Scale	
R. W. O	Eng. K. Limo	Checked	
DRG No.			

MINISTRY OF LANDS, PUBLIC WORKS, HOUSING AND URBAN DEVELOPMENT

STATE DEPARTMENT FOR PUBLIC WORKS CENTRAL RIFT REGION

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA



NOTES

1. The drawing is protected under the copyright Act and cannot be used or reproduced in part or in whole withought authors consent.
2. All dimensions are to be checked on site and cannot be written on dimension rules over scaled dimensions.
3. P. V denotes permant ventilation and must be provided above all fenestrations. and indicated on plans;
   - f.g.l - denotes finished ground Level
   - p.v.c - denotes poly vinyl chloride
   - m.h - denotes man hole
   - w.h.b - denotes wash hand basin
   - s.v.p - denotes soil vent pipe
   - w.c - denotes water closet
   - g.t. - denotes gulley trap
   - f.t - denotes floor trap
   - sh. - denotes shower
4. D. P. C denotes damp proof course, one layer of bituminous felt and must be provided on all bearing walls.
5. All walls must be reinforced with hoop iron at every alternate course.
6. Plinth level to a minimum of 300mm from ground level.
7. Depth of foundation trenches to be a minimum of 600mm below the reduced level.
8. All dimensions are in mm (millimeters) unless otherwise stated.
9. All reinforced concrete (R. C) works and trusses should the to Structural Engineers specs.
10. All sanitary and sewarage works to comply with the Public Health regulations.
11. All burried drainage pipes should be of class "41" golden brownKey Terrain U. P. V. C.
12. Drainage pipes passing under the building should be encased in 150mm thick concrete surrounding.

CONSULTANTS

PROJECT	*PROPOSED MODERN OFFICE COMPLEX*
CLIENT	*COUNTY COMMISSIONERS OFFICE AT ITEN EMC FOR MINISTRY OF INTERIOR P. O. BOX ..... - 30100 ELDORET.*
ITEM(S)	Second Floor Plan

A. A	Malachi W.	Date	October, 2026
R. A	Eng. K. Limo	Scale	
R. W. O	Eng. K. Limo	Checked	
DRG No.			

MINISTRY OF LANDS, PUBLIC WORKS, HOUSING AND URBAN DEVELOPMENT

STATE DEPARTMENT FOR PUBLIC WORKS CENTRAL RIFT REGION

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA



NOTES

1. The drawing is protected under the copyright Act and cannot be used or reproduced in part or in whole withought authors consent.
2. All dimensions are to be checked on site and cannot be written on dimension rules over scaled dimensions.
3. P. V denotes permant ventilation and must be provided above all fenestrations. and indicated on plans;
   - f.g.l - denotes finished ground Level
   - p.v.c - denotes poly vinyl chloride
   - m.h - denotes man hole
   - w.h.b - denotes wash hand basin
   - s.v.p - denotes soil vent pipe
   - w.c - denotes water closet
   - g.t. - denotes gulley trap
   - f.t - denotes floor trap
   - sh. - denotes shower
4. D. P. C denotes damp proof course, one layer of bituminous felt and must be provided on all bearing walls.
5. All walls must be reinforced with hoop iron at every alternate course.
6. Plinth level to a minimum of 300mm from ground level.
7. Depth of foundation trenches to be a minimum of 600mm below the reduced level.
8. All dimensions are in mm (millimeters) unless otherwise stated.
9. All reinforced concrete (R. C) works and trusses should the to Structural Engineers specs.
10. All sanitary and sewarage works to comply with the Public Health regulations.
11. All burried drainage pipes should be of class "41" golden brownKey Terrain U. P. V. C.
12. Drainage pipes passing under the building should be encased in 150mm thick concrete surrounding.

CONSULTANTS


PROJECT	*PROPOSED MODERN OFFICE COMPLEX*		
CLIENT	*COUNTY COMMISSIONERS OFFICE AT ITEN EMC FOR MINISTRY OF INTERIOR P. O. BOX ..... - 30100 ELDORET.*		
ITEM(S)	Third Floor Plan		
A. A	Malachi W.	Date	October, 2026
R. A	Eng. K. Limo	Scale	
R. W. O	Eng. K. Limo	Checked	
DRG No.			

MINISTRY OF LANDS, PUBLIC WORKS, HOUSING AND URBAN DEVELOPMENT

STATE DEPARTMENT FOR PUBLIC WORKS CENTRAL RIFT REGION

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA



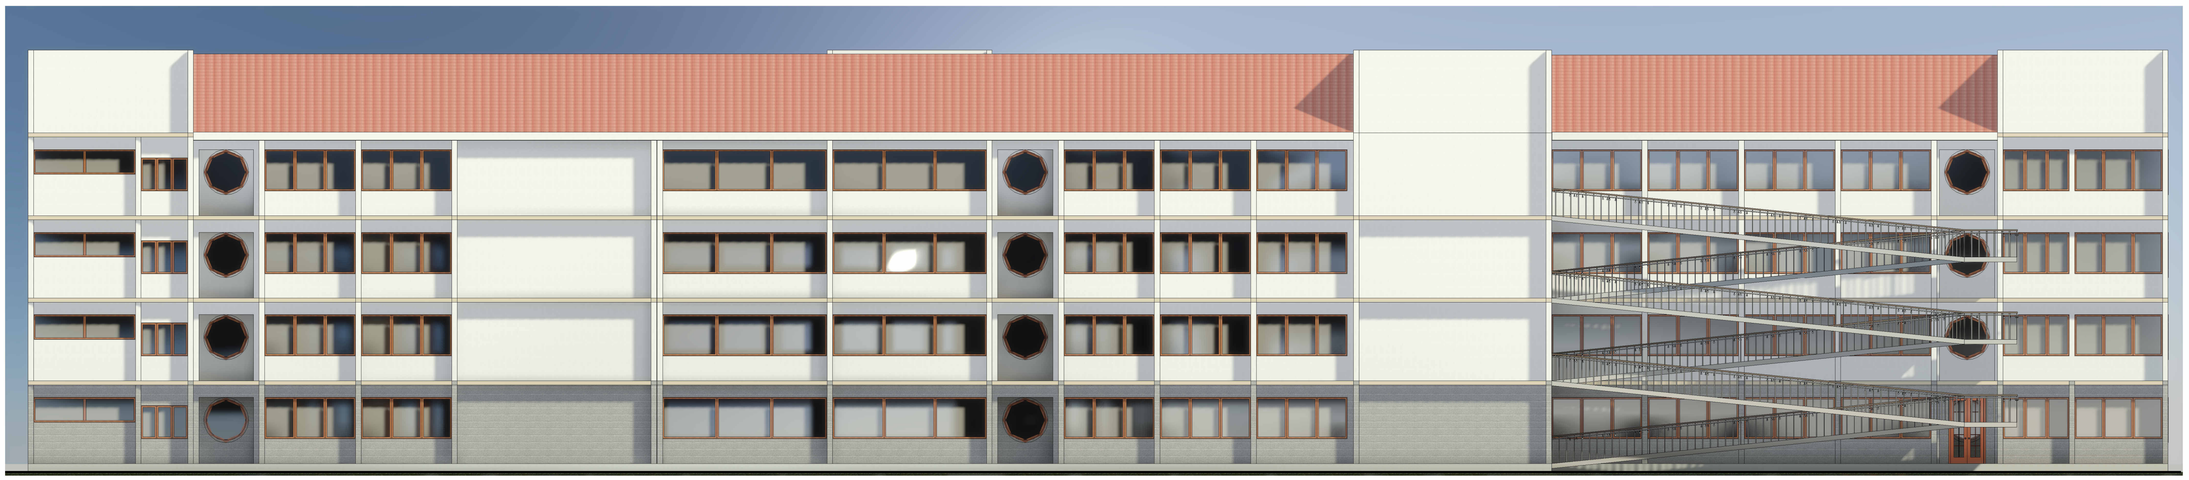

NOTES

1. The drawing is protected under the copyright Act and cannot be used or reproduced in part or in whole withought authors consent.
2. All dimensions are to be checked on site and cannot be written on dimension rules over scaled dimensions.
3. P. V denotes permant ventilation and must be provided above all fenestrations. and indicated on plans;
   - f.g.l - denotes finished ground Level
   - p.v.c - denotes poly vinyl chloride
   - m.h - denotes man hole
   - w.h.b - denotes wash hand basin
   - s.v.p - denotes soil vent pipe
   - w.c - denotes water closet
   - g.t. - denotes gulley trap
   - f.t - denotes floor trap
   - sh. - denotes shower
4. D. P. C denotes damp proof course, one layer of bituminous felt and must be provided on all bearing walls.
5. All walls must be reinforced with hoop iron at every alternate course.
6. Plinth level to a minimum of 300mm from ground level.
7. Depth of foundation trenches to be a minimum of 600mm below the reduced level.
8. All dimensions are in mm (millimeters) unless otherwise stated.
9. All reinforced concrete (R. C) works and trusses should the to Structural Engineers specs.
10. All sanitary and sewarage works to comply with the Public Health regulations.
11. All burried drainage pipes should be of class "41" golden brownKey Terrain U. P. V. C.
12. Drainage pipes passing under the building should be encased in 150mm thick concrete surrounding.

CONSULTANTS	
PROJECT	*PROPOSED MODERN OFFICE COMPLEX*
CLIENT	*COUNTY COMMISSIONERS OFFICE AT ITEN EMC FOR MINISTRY OF INTERIOR P. O. BOX ..... - 30100 ELDORET.*
ITEM(S)	Elevations

A. A	Malachi W.	Date	October, 2026
R. A	Eng. K. Limo	Scale	1:75
R. W. O	Eng. K. Limo	Checked	
DRG No.			

MINISTRY OF LANDS, PUBLIC WORKS, HOUSING AND URBAN DEVELOPMENT

STATE DEPARTMENT FOR PUBLIC WORKS CENTRAL RIFT REGION

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA





NOTES

1. The drawing is protected under the copyright Act and cannot be used or reproduced in part or in whole withought authors consent.
2. All dimensions are to be checked on site and cannot be written on dimension rules over scaled dimensions.
3. P. V denotes permant ventilation and must be provided above all fenestrations. and indicated on plans;
   - f.g.l - denotes finished ground Level
   - p.v.c - denotes poly vinyl chloride
   - m.h - denotes man hole
   - w.h.b - denotes wash hand basin
   - s.v.p - denotes soil vent pipe
   - w.c - denotes water closet
   - g.t. - denotes gulley trap
   - f.t - denotes floor trap
   - sh. - denotes shower
4. D. P. C denotes damp proof course, one layer of bituminous felt and must be provided on all bearing walls.
5. All walls must be reinforced with hoop iron at every alternate course.
6. Plinth level to a minimum of 300mm from ground level.
7. Depth of foundation trenches to be a minimum of 600mm below the reduced level.
8. All dimensions are in mm (millimeters) unless otherwise stated.
9. All reinforced concrete (R. C) works and trusses should the to Structural Engineers specs.
10. All sanitary and sewarage works to comply with the Public Health regulations.
11. All burried drainage pipes should be of class "41" golden brownKey Terrain U. P. V. C.
12. Drainage pipes passing under the building should be encased in 150mm thick concrete surrounding.

CONSULTANTS

PROJECT	*PROPOSED MODERN OFFICE COMPLEX*		
CLIENT	*COUNTY COMMISSIONERS OFFICE AT ITEN EMC FOR MINISTRY OF INTERIOR P. O. BOX ..... - 30100 ELDORET.*		
ITEM(S)	Elevations		
A. A	Malachi W.	Date	October, 2026
R. A	Eng. K. Limo	Scale	
R. W. O	Eng. K. Limo	Checked	
DRG No.			

MINISTRY OF LANDS, PUBLIC WORKS, HOUSING AND URBAN DEVELOPMENT

STATE DEPARTMENT FOR PUBLIC WORKS CENTRAL RIFT REGION

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA





NOTES

1. The drawing is protected under the copyright Act and cannot be used or reproduced in part
   or in whole withought authors consent.
2. All dimensions are to be checked on site and cannot be written on dimension rules over scaled dimensions.
3. P. V denotes permant ventilation and must be provided above all fenestrations.
   and indicated on plans;
   - f.g.l - denotes finished ground Level
   - p.v.c - denotes poly vinyl chloride
   - m.h - denotes man hole
   - w.h.b - denotes wash hand basin
   - s.v.p - denotes soil vent pipe
   - w.c - denotes water closet
   - g.t. - denotes gulley trap
   - f.t - denotes floor trap
   - sh. - denotes shower
4. D. P. C denotes damp proof course, one layer of bituminous felt and must be provided on all bearing walls.
5. All walls must be reinforced with hoop iron at every alternate course.
6. Plinth level to a minimum of 300mm from ground level.
7. Depth of foundation trenches to be a minimum
   of 600mm below the reduced level.
8. All dimensions are in mm (millimeters) unless otherwise stated.
9. All reinforced concrete (R. C) works and trusses should the to Structural Engineers specs.
10. All sanitary and sewarage works to comply with the Public Health regulations.
11. All burried drainage pipes should be of class "41" golden brownKey Terrain U. P. V. C.
12. Drainage pipes passing under the building should be encased in 150mm thick concrete surrounding.

CONSULTANTS

PROJECT	*PROPOSED MODERN OFFICE COMPLEX*		
CLIENT	*COUNTY COMMISSIONERS OFFICE AT ITEN* *EMC FOR MINISTRY OF INTERIOR* *P. O. BOX ..... - 30100* *ELDORET.*		
ITEM(S)			
A. A	Malachi W.	Date	October, 2026
R. A	Eng. K. Limo	Scale	
R. W. O	Eng. K. Limo	Checked	
DRG No.			

MINISTRY OF LANDS, PUBLIC WORKS, HOUSING AND URBAN DEVELOPMENT

STATE DEPARTMENT FOR PUBLIC WORKS
CENTRAL RIFT REGION

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA