
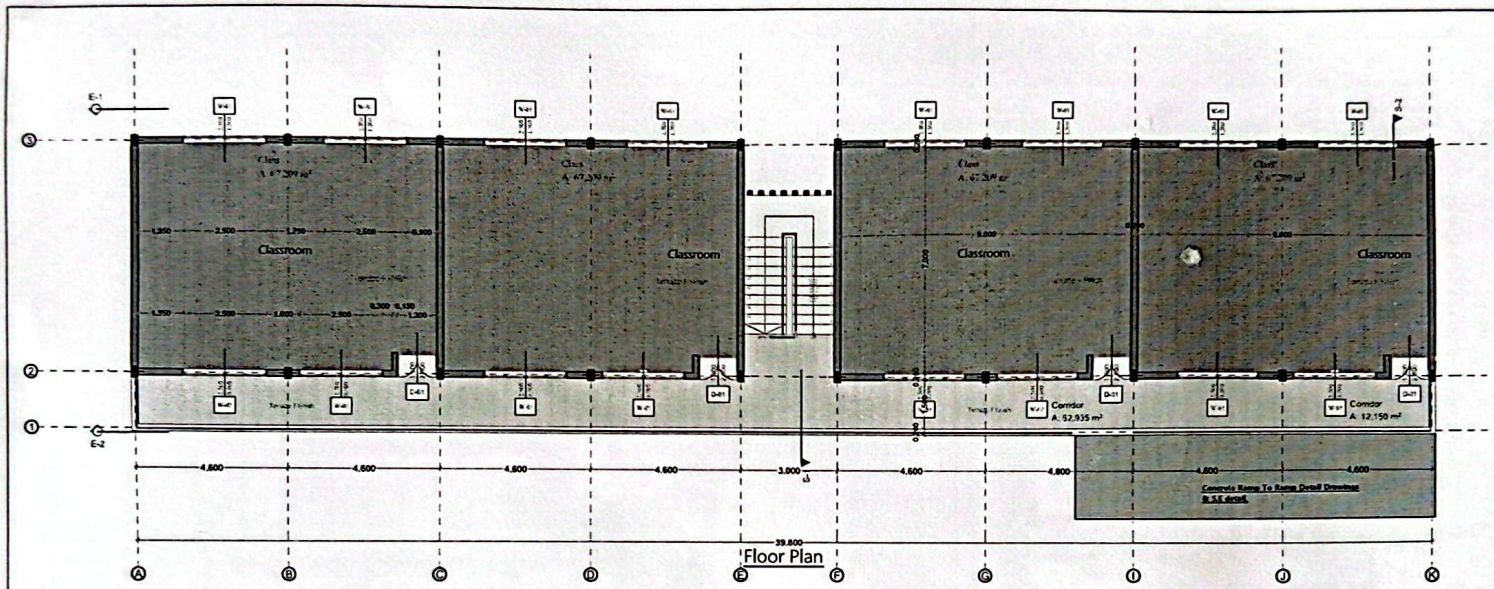


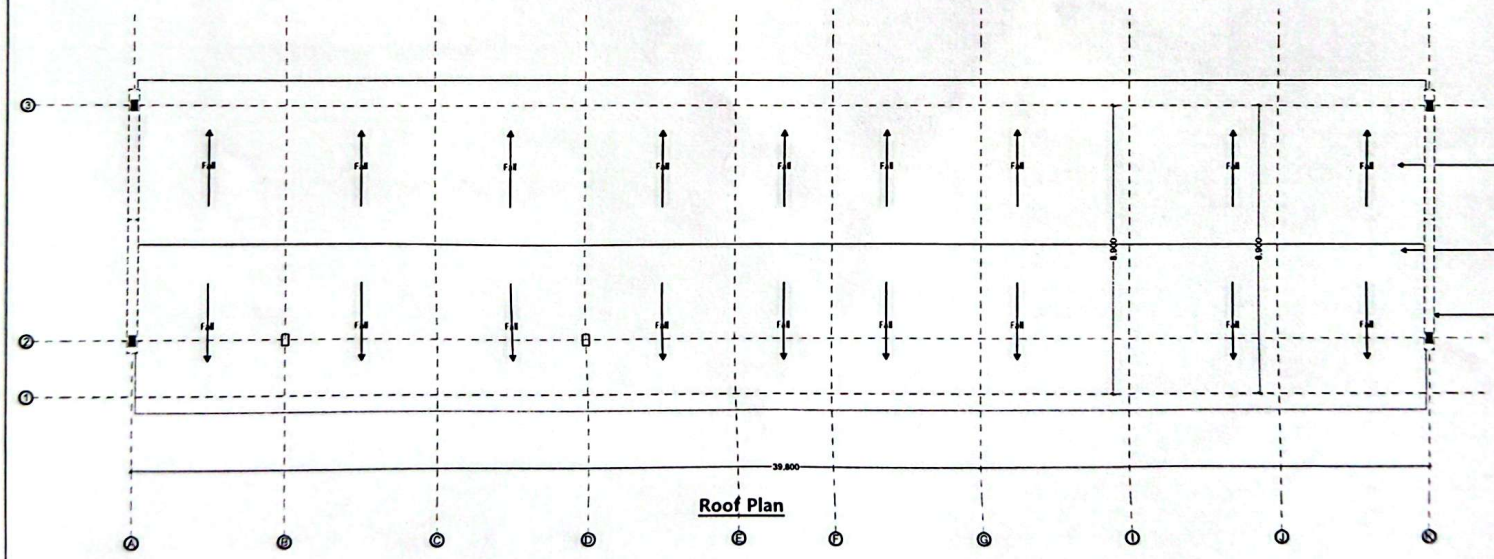

NOTES

General
All dimensions are in mm unless otherwise specified, drawings are not to be scaled.
Only figured dimensions to be used.
The contractor must check and verify all the dimensions before commencement of the work.

Mechanical
All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage.Drains passing beneath buildings and driveways to be encased in 150mm concrete surround.
All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
all inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS.556.
Minimum slope in the drain pipes to be 1%.
No chases for pipes will be allowed in the slabs.

Sleeves will be allowed with written approval from the SE.
No cutting of concrete without express approval of the architect or SE.All testing of pipes to must be coordinated with electrical & any conflicts must be clarified before works begin.
P.V denotes permanent vents.
All column specs and details to S.E drawings and instructions

Revisions

Project
4 door Proposed Classroom Block

Drawing Title Floor Plan, Roof Plan

Client Ministry/Department
Infinity Primary School

Client Signature.....

Scale		
	1	1:100
	2	
	3	

Project Job No.
JOB NO.....

Drawing No.


	Name	Sign	Date
Designed by			
Checked by			
Regional Architect			


Approved
M.K. KIMANI
REGIONAL WORKS OFFICER

MINISTRY OF TRANSPORT, INFRASTRUCTURE, PUBLIC WORKS HOUSING & URBAN DEVELOPMENT
FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

REGIONAL WORKS OFFICER
NAIROBI REGION
STATE DEPARTMENT OF PUBLIC WORKS
P. O. Box 42267 - 00100, NAIROBI

CamScanner

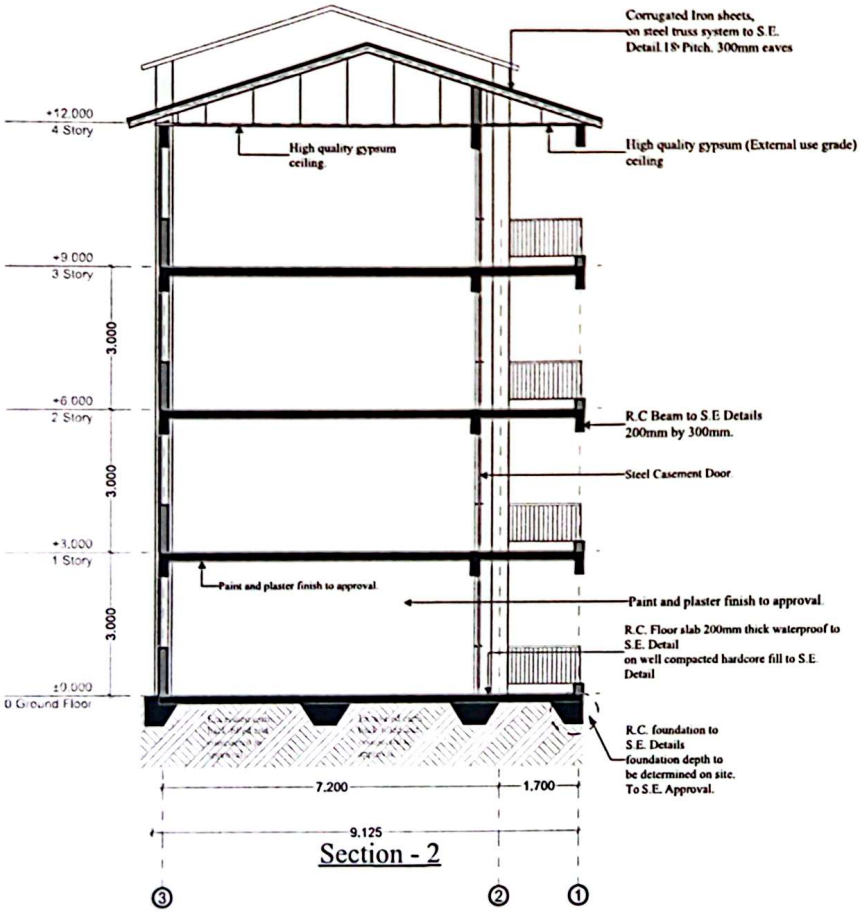

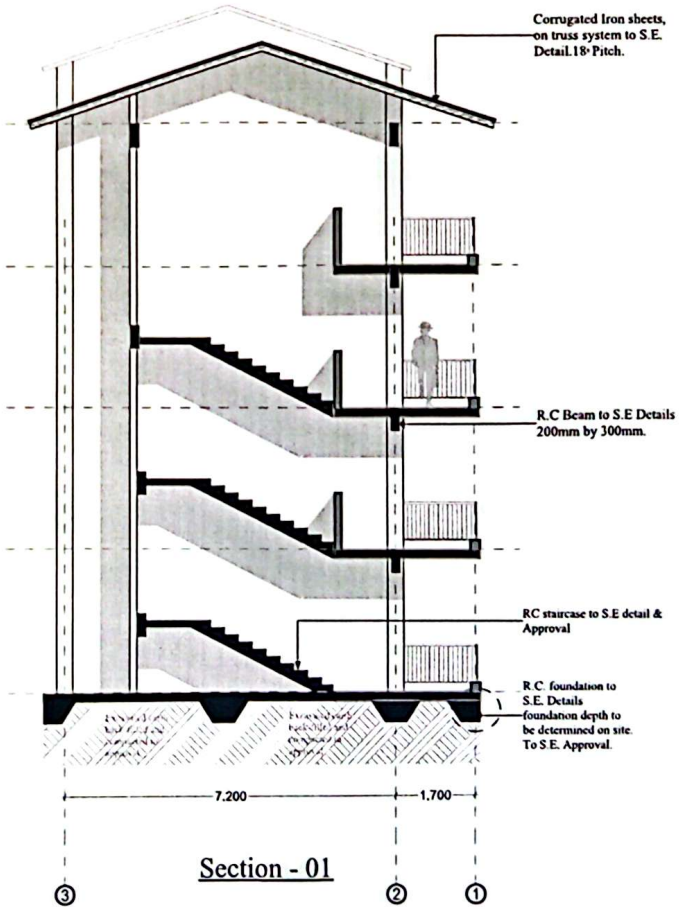

NOTES

General
All dimesions are in mm unless otherwise specified, drawings are not to be scaled.
Only figured dimensions to be used. The contractor must check and verify all the dimensions before commencement of the work.

Mechanical
All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage.Drains passing beneath buildings and driveways to be encased in 150mm concrete surround.
All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
all inspection chambers covers and framing shall be cast iron to comply with BS 497 Table 2 Grade A.
The storm water drain pipes to comply with BS.556.
Minimum slope in the drain pipes to be 1%.
No chases for pipes will be allowed in the slabs.

Sleeves will be allowed with written approval from the SE.
No cutting of concrete without express approval of the architect or SE.All testing of pipes to must be coordinated with electrical & any conflicts must be clarified before works begin.
P.V denotes permanent vents.
All column specs and details to S.E drawings and instructions.

Revisions

Project
Proposed Classroom Block

Drawing Title Section 2

Client Ministry/Department

Client Signature.....

Scale		
	1	1:100
	2	
	3	

Project Job No.
JOB NO.....

Drawing No.
.....

	Name	Signed	Date
Designed by	P.Wanda		20/05/2025
Checked by			20/05/2025
Regional Architect	J.M. Thiru		20/05/2025

Approved


M.K. KIMANI
REGIONAL WORKS OFFICER

MINISTRY OF TRANSPORT, INFRASTRUCTURE ,PUBLIC WORKS HOUSING & URBAN DEVELOPMENT


REGIONAL WORKS OFFICE ARCHITECTURAL DEPT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

CamScanner

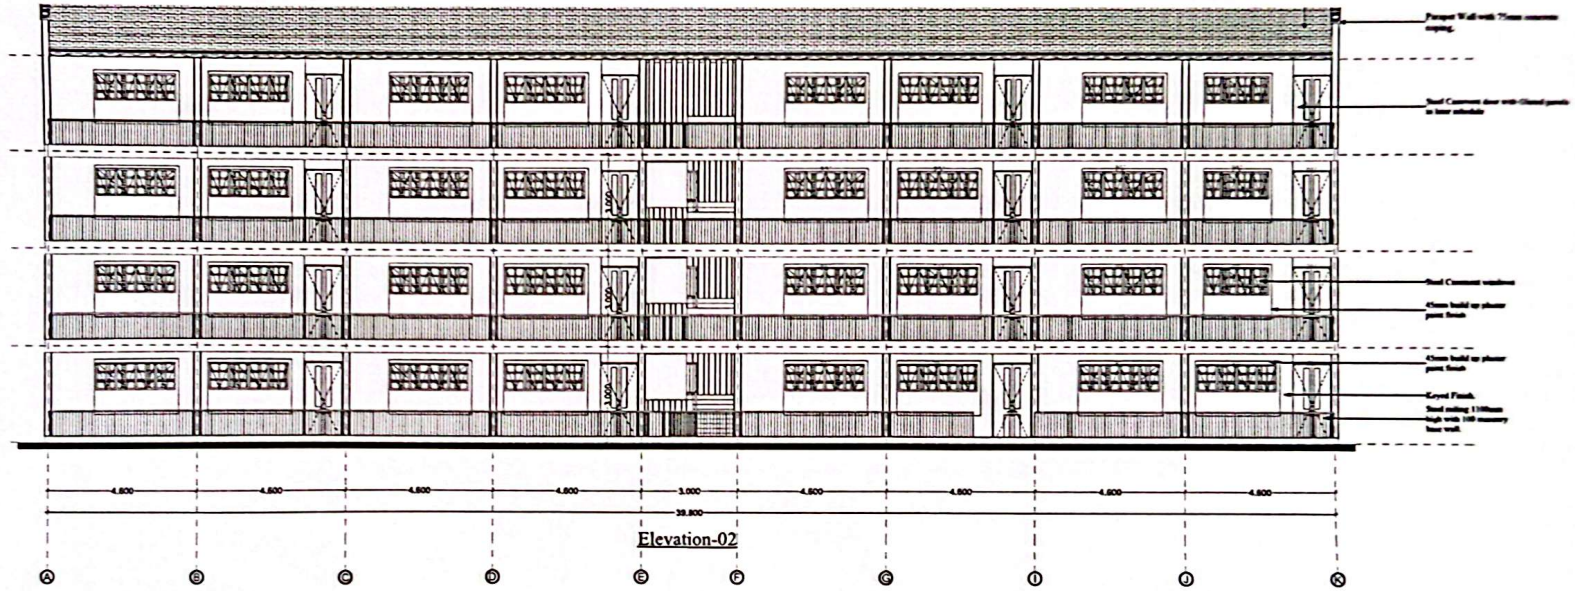

Elevation-02

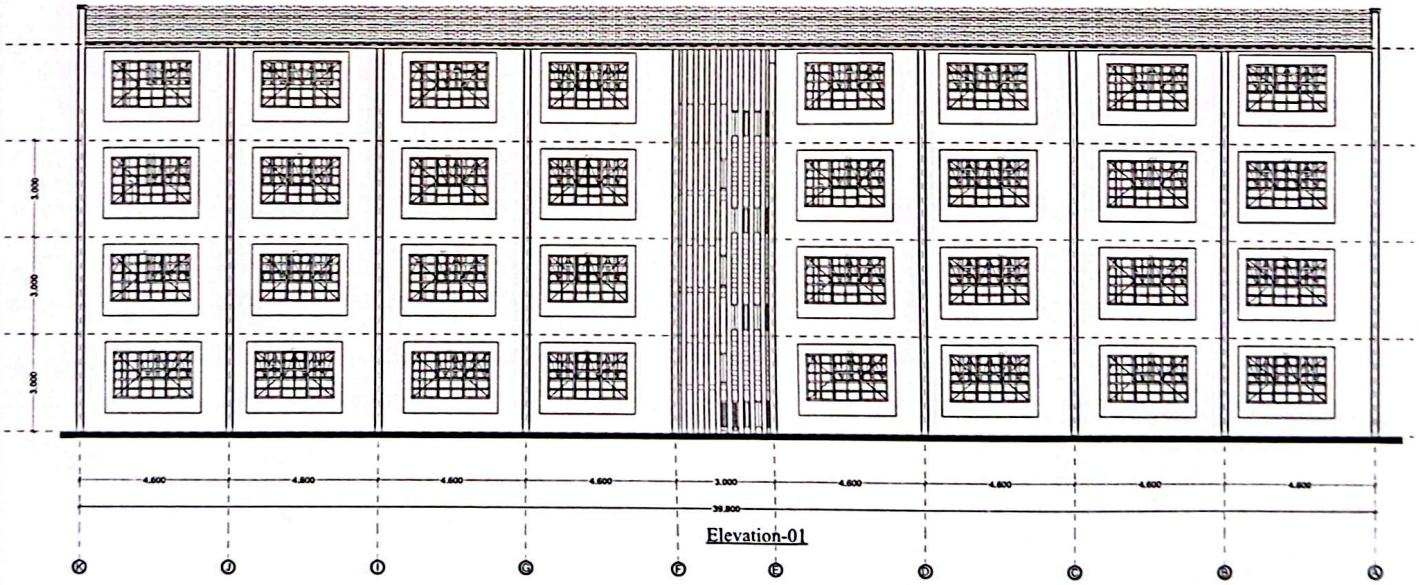

Elevation-01

NOTES

General
All dimensions are in mm unless otherwise specified, drawings are not to be scaled. Only figured dimensions to be used. The contractor must check and verify all the dimensions before commencement of the work.

Mechanical
All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage.Drains passing beneath buildings and driveways to be encased in 150mm concrete surround.
All underground foul & waste drain pipes shall be of PVC, to comply with BS5255.
all inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS.556.
Minimum slope in the drain pipes to be 1%.
No chases for pipes will be allowed in the slabs.

Sleeves will be allowed with written approval from the SE.
No cutting of concrete without express approval of the architect or SE.All testing of pipes to must be coordinated with electrical & any conflicts must be clarified before works began.
P.V denotes permanent vents.
All columns specs and details to S.E drawings and instructions

Revisions

Project
4 door Proposed Classroom Block

Drawing Title Roof Plan

Client Ministry/Department
Infinity Primary School

Client Signature.....

Scale		
	1	1:100
	2	
	3	

Project Job No.
JOB NO.....

Drawing No.


	Name	Signature	Date
Designed by	P.Wanza		20/01/2025
Checked by			20/01/2025
Regional Architect			20/01/2025

Approved


M.K. KIMANI
REGIONAL WORKS OFFICER

MINISTRY OF TRANSPORT, INFRASTRUCTURE, PUBLIC WORKS, HOUSING & URBAN DEVELOPMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

Window Schedule		
Element ID	W-01	W-02
W x H Size	2.500×1.500	2.000×0.900
Description	Steel casement window...	Steel casement window...
Sill height	1.000	1.600
Head height	2.500	2.500
2D Symbol		
3D Back View		

Door Schedule	
Element ID	D-01
Description	Steel casement door with Glazed Panels
Sill height	0.000
Head height	2.500
2D Symbol	
3D Back View	

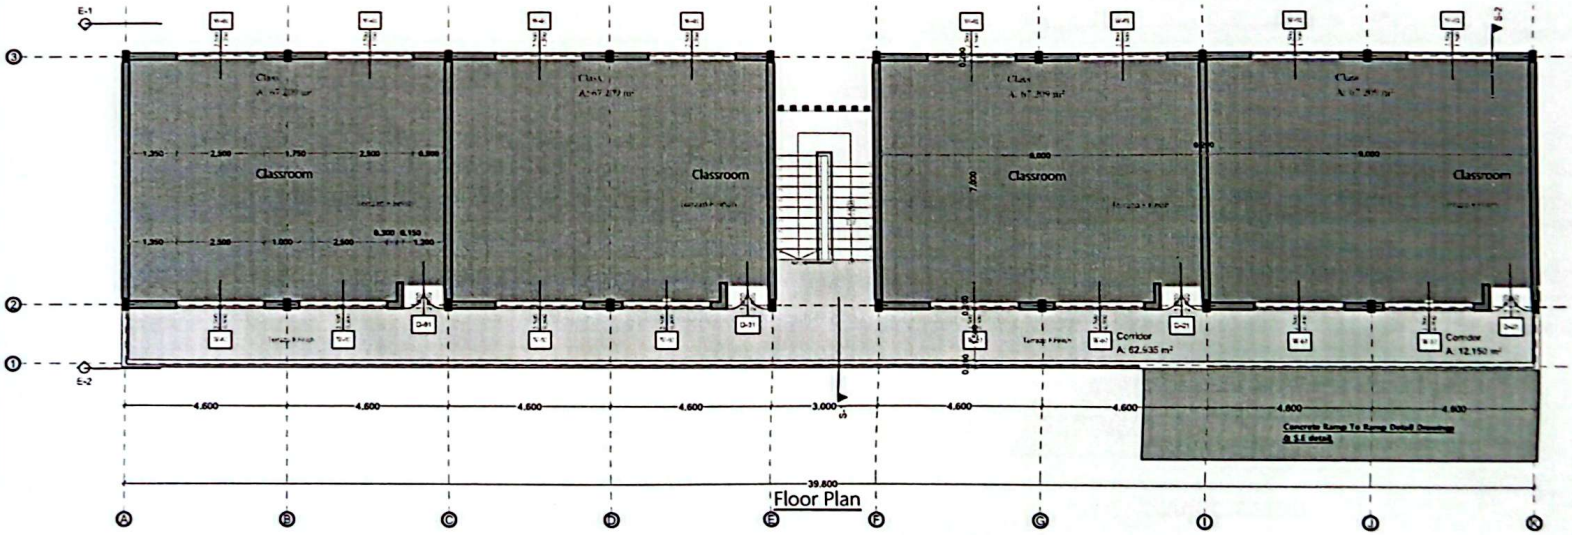

Floor Plan

NOTES

General
All dimensions are in mm unless otherwise specified, drawings are not to be scaled.
Only figured dimensions to be used. The contractor must check and verify all the dimensions before commencement of the work.

Mechanical
All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage.Drains passing beneath buildings and driveways to be encased in 150mm concrete surround.
All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
all inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS.556.
Minimum slope in the drain pipes to be 1%.
No chases for pipes will be allowed in the slabs.

Sleeves will be allowed with written approval from the S.E.
No cutting of concrete without express approval of the architect or S.E.All testing of pipes to must be coordinated with electrical & any conflicts must be clarified before works begin.
P.V denotes permanent vents.
All column specs and details to S.E drawings and instructions.

Revisions

Project
Proposed Classroom Block

Drawing Title Window/ Door Schedule

Client Ministry/Department

Client Signature.....

Scale		
	1	1:1,
	2	1:131.78
	3	

Project Job No.
JOB NO.....

Drawing No.
.....

	Name	Signed	Date
Designed by	P.Wanda		20/05/2025
Checked by			20/05/2025
Regional Architect	J.M. Thiru		20/05/2025

Approved

M.K. KIMANI
REGIONAL WORKS OFFICER

MINISTRY OF TRANSPORT, INFRASTRUCTURE ,PUBLIC WORKS HOUSING & URBAN DEVELOPMENT


REGIONAL WORKS OFFICE
ARCHITECTURAL DEPT.

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA


CamScanner

R.C Ramp 1400mm wide
Non slip Terrazzo F.F with
150mm by 150mm masonry
Flanges on each
Side.

1100mm high railing with steel rail panels to later detail.

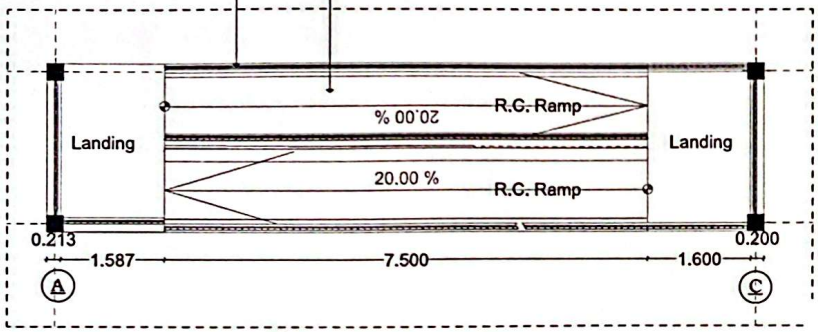

Ramp Plan (1st Floor)

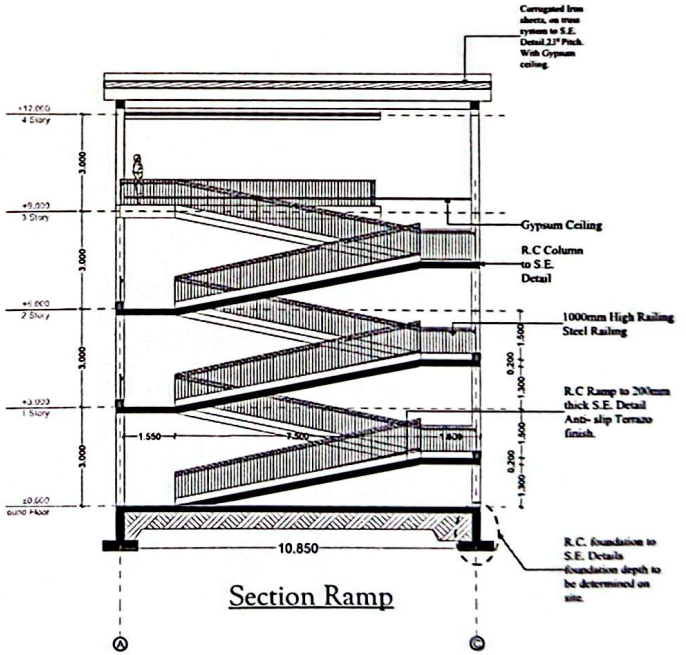

Section Ramp

NOTES

General
All dimensions are in mm unless otherwise specified, drawings are not to be scaled.
Only figured dimensions to be used.
The contractor must check and verify all the dimensions before commencement of the work.

Mechanical
All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage.Drains passing beneath buildings and driveways to be encased in 150mm concrete surround.
All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
all inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS.556.
Minimum slope in the drain pipes to be 1%.
No chases for pipes will be allowed in the slabs.

Sleeves will be allowed with written approval from the SE.
No cutting of concrete without express approval of the architect or SE.All testing of pipes to must be coordinated with electrical & any conflicts must be clarified before works began.
P.V denotes permanent vents.
All column specs and details to S.E drawings and instructions

Revisions

Project
4 door Proposed Classroom Block

Drawing Title Floor Plan

Client Ministry/Department
Infinity Primary School

Client Signature.....

Scale		
	1	1:1
	2	
	3	

Project Job No. JOB NO.....			Drawing No.
	Name	Signed	Date
Designed by	P Wanja		28/05/2025
Checked by			28/05/2025
Regional Architect			28/05/2025

Approved

M.K. KIMANI
REGIONAL WORKS OFFICER

MINISTRY OF TRANSPORT, INFRASTRUCTURE ,PUBLIC WORKS HOUSING & URBAN DEVELOPMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

CamScanner