0.

GROUND FLOOR PLAN LAYOUT

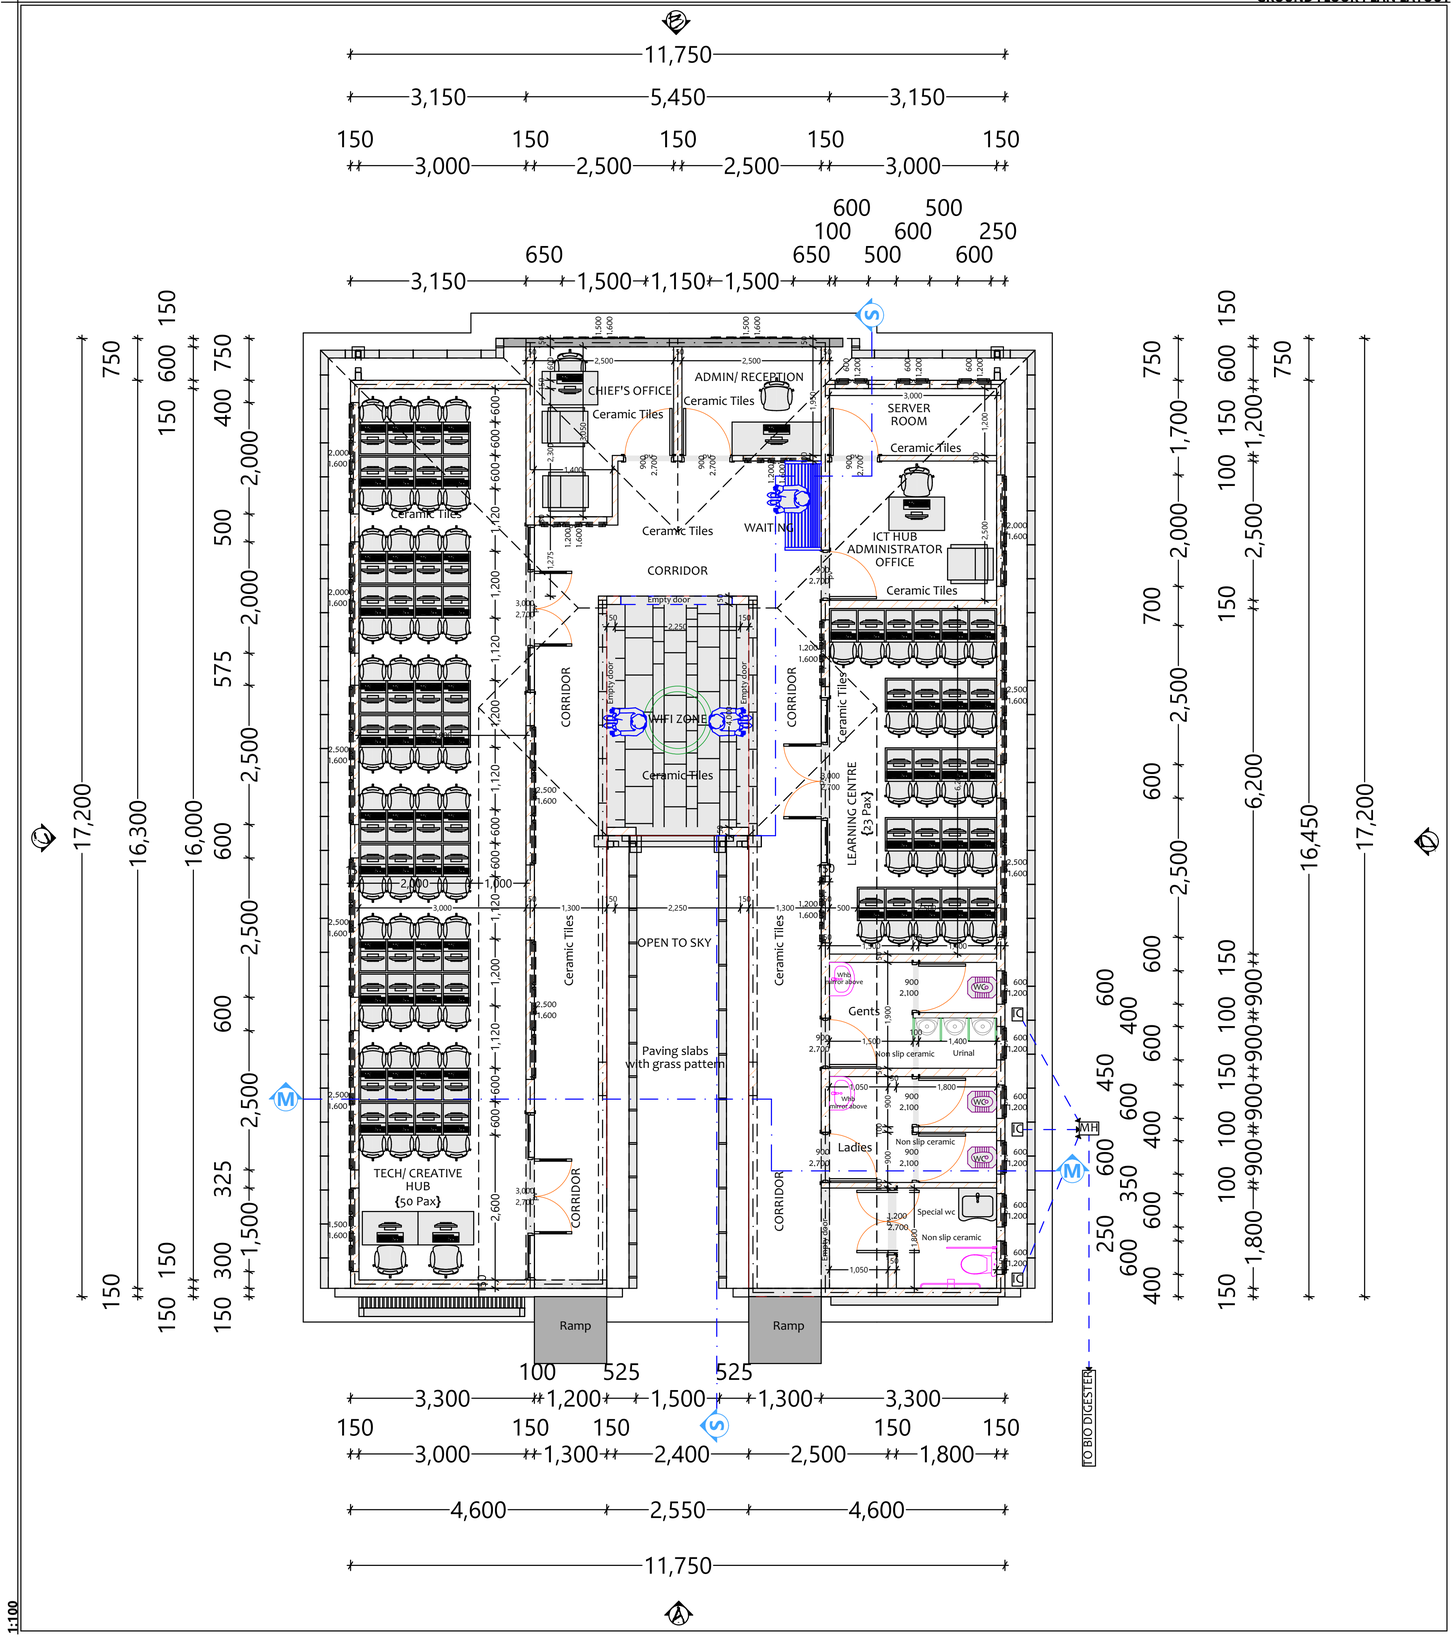

NOTES

1. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE STATED
2. THE STRUCTURAL DRAWING S SHALL BE READ IN CONJUCTION WITH ARCHITECTURAL DRAWINGS, AND IN THE EVENT OF ANY DESCREPANCIES, THE ENGINEER AND THE ARCHITECT SHALL BE NOTIFIED BEFORE PROCEEDING WITH THE WORK.
3. ALL DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR AND DRAWINGS SHALL NOT BE SCALED OFF. ONLY FIGURED DIMENSIONS SHALL BE USED.
4. CONCRETE SHALL HAVE 20 MM MAXIMUM SIZE OF AGGREGATES AND SHALL BE ADEQUATELY VIBRATED.
5. BLINDING CONCRETE SHALL BE CLASS 10/20 (1:4:8) MIX AND SHALL BE 50 MM THICK UNLESS OTHERWISE STAT E D.
6. BUILDING BLOCKS SHALL BE ADEQUATELY BONDED AND SET IN 1:3 CEMENT/SAND MORTAR.
7. STEEL REINFORCEMENT SHALL BE COLD WORKED BARS TO B.S. 4449 REF.
8. CONCRETE COVERS SHALL BE AS FOLLOWS :-
   - 50 MM FOR FOUNDATIONS
   - 40 MM FOR COLUMNS
   - 20 MM FOR SLABS AND STAIR-CASES
   - 25 MM FOR BEAMS
9. THE CONTRACTOR SHALL VERIFY THE DIMENSIONS GIVEN IN THE BENDING SCHEDULES BEFORE CUTTING AND BENDIN G STEEL REINFORCEMENT.
10. THESE NOTES DO NOT SUPERCEED THE SPECIFICATIONS AND THE CONTRACTOR SHALL CONSULT THE ENGINEER IN EVENT OF ANY CONTRADICTIONS.
11. ALL LOAD BEARING MASONRY WALLS, TO BE OF GOOD BUILDING STONE TO THE ENGINEER`S SATISFACTION JOINTED IN 1:3 MORTAR WITH A MINIMUM CRUSHING STRENGH OF 10 N/MM AND.
12. GRID SETTING TO BE CHECKED AND APPROVED BY THE ENGINEER.
13. FOUNDATION LEVEL TO BE SET AS PER THE CIVIL WORKS DRAWINGS AND TO BE DETERMINED BY THE ENGINEER ON SITE.
14. NO STEPS TO BE ALLOWED IN THE FOUNDATION UNLESS SPECIFIED BY THE ENGINEER.
15. TIMBER TO BE WELL SEASONED GENERAL GRADE CYPRESS OR EQUIVALENT TO THE ENGINEERS APPROVAL.
16. MINIMUM LOAD BEARING CONCRETE BLOCKS STRENGTH > 7 N/mm²
17. H/BLOCKS STRENGTH MINIMUM 13 KN/MM²

APPROVALS

CLIENT

NATIONAL GOVERNMENT CONSTITUENCIES DEVELOPMENT FUND - NYERI TOWN

DRAWING TITTLE

FLOOR PLAN LAYOUT.

PROJECT TITLE·

PROPOSED CONSTRUCTION OF MUNUNGA-INI ICT DIGITAL HUB.

Job no NG CDF-NT/M/ICTDH/11-26	**Scale** AS INDICATED
Date NOVEMBER 2026	**Total Square Metres** 175.58M²
Design by & Drawn by	HARRISON GICHUKI MWAI CLERK OF WORKS NG CDF- NYERI TOWN
Checked & Approved by:	

MINISTRY OF PUBLIC WORKS, HOUSING & URBAN DEVELOPMENT.
STATE DEPARTMENT FOR PUBLIC WORKS
COUNTY WORKS OFFICER, NYERI.
P.O.BOX 372 - 10100,
NYERI

A

Elevation

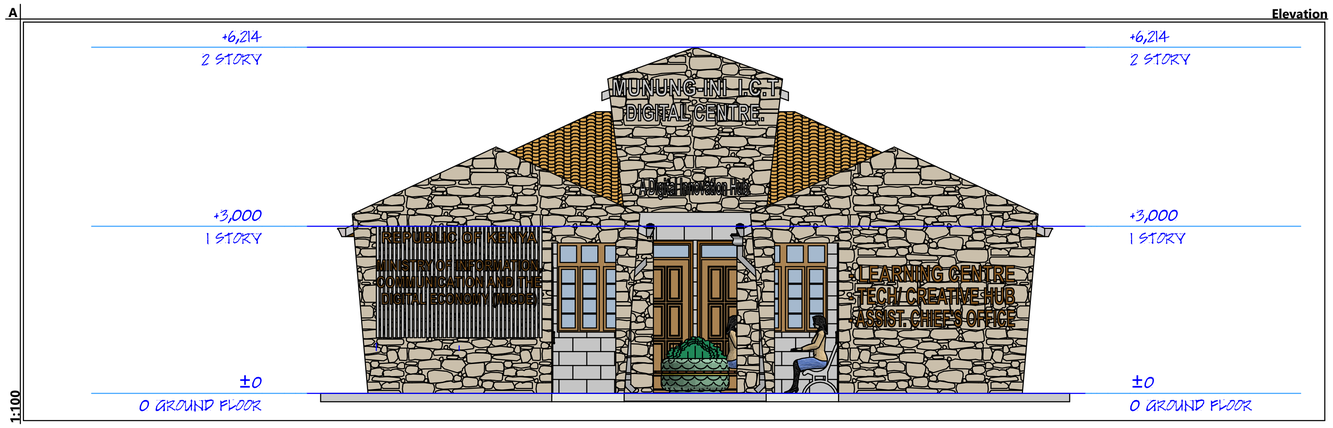

1:100

B

Elevation

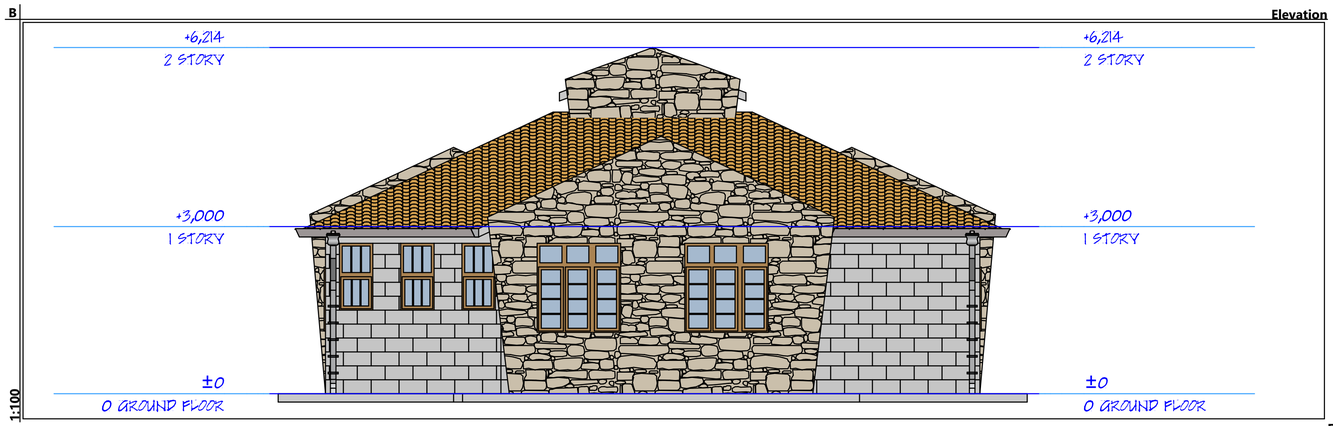

1:100

C

Elevation

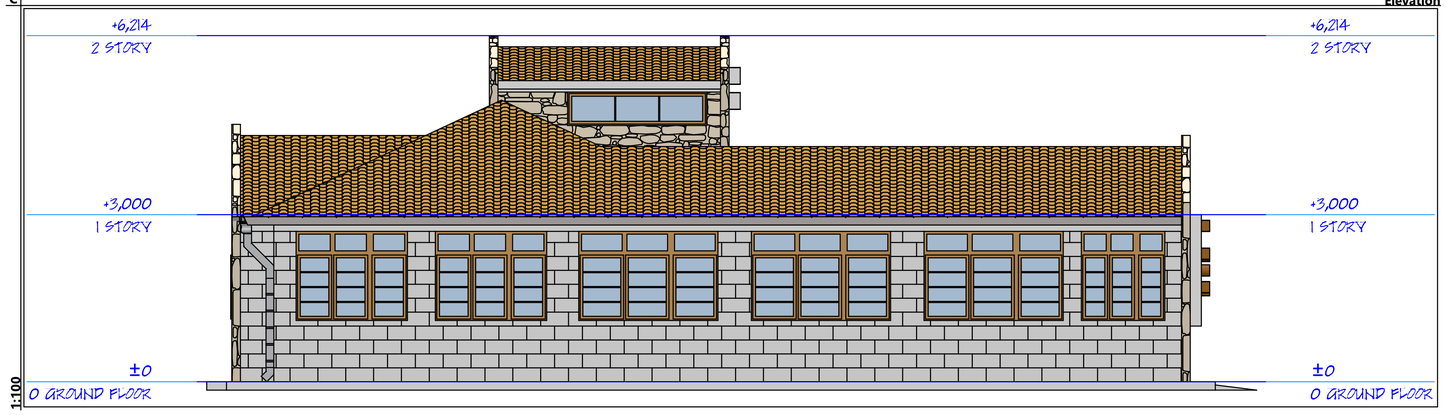

1:100

D

Elevation

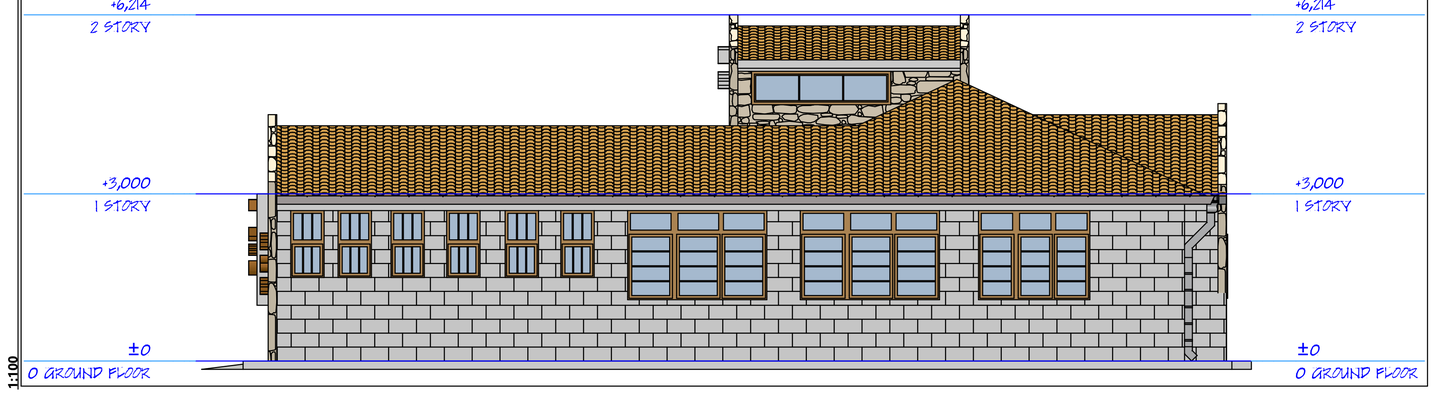

1:100

NOTES

1. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE STATED
2. THE STRUCTURAL DRAWING S SHALL BE READ IN CONJUCTION WITH ARCHITECTURAL DRAWINGS, AND IN THE EVENT OF ANY DESCREPANCIES, THE ENGINEER AND THE ARCHITECT SHALL BE NOTIFIED BEFORE PROCEEDING WITH THE WORK.
3. ALL DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR AND DRAWINGS SHALL NOT BE SCALED OFF. ONLY FIGURED DIMENSIONS SHALL BE USED.
4. CONCRETE SHALL HAVE 20 MM MAXIMUM SIZE OF AGGREGATES AND SHALL BE ADEQUATELY VIBRATED.
5. BLINDING CONCRETE SHALL BE CLASS 10/20 (1:4:8) MIX AND SHALL BE 50 MM THICK UNLESS OTHERWISE STAT E D.
6. BUILDING BLOCKS SHALL BE ADEQUATELY BONDED AND SET IN 1:3 CEMENT/SAND MORTAR.
7. STEEL REINFORCEMENT SHALL BE COLD WORKED BARS TO B.S. 4449 REF.
8. CONCRETE COVERS SHALL BE AS FOLLOWS :-
   - 50 MM FOR FOUNDATIONS
   - 40 MM FOR COLUMNS
   - 20 MM FOR SLABS AND STAIR-CASES
   - 25 MM FOR BEAMS
9. THE CONTRACTOR SHALL VERIFY THE DIMENSIONS GIVEN IN THE BENDING SCHEDULES BEFORE CUTTING AND BENDIN G STEEL REINFORCEMENT.
10. THESE NOTES DO NOT SUPERCEED THE SPECIFICATIONS AND THE CONTRACTOR SHALL CONSULT THE ENGINEER IN EVENT OF ANY CONTRADICTIONS.
11. ALL LOAD BEARING MASONRY WALLS, TO BE OF GOOD BUILDING STONE TO THE ENGINEER`S SATISFACTION JOINTED IN 1:3 MORTAR WITH A MINIMUM CRUSHING STRENGH OF 10 N/MM AND.
12. GRID SETTING TO BE CHECKED AND APPROVED BY THE ENGINEER.
13. FOUNDATION LEVEL TO BE SET AS PER THE CIVIL WORKS DRAWINGS AND TO BE DETERMINED BY THE ENGINEER ON SITE.
14. NO STEPS TO BE ALLOWED IN THE FOUNDATION UNLESS SPECIFIED BY THE ENGINEER.
15. TIMBER TO BE WELL SEASONED GENERAL GRADE CYPRESS OR EQUIVALENT TO THE ENGINEERS APPROVAL.
16. MINIMUM LOAD BEARING CONCRETE BLOCKS STRENGTH > 7 N/mm²
17. H/BLOCKS STRENGTH MINIMUM 13 KN/MM²

APPROVALS

CLIENT

NATIONAL GOVERNMENT CONSTITUENCIES DEVELOPMENT FUND - NYERI TOWN

DRAWING TITTLE

ELEVATION LAYOUT.

PROJECT TITLE·

PROPOSED CONSTRUCTION OF MUNUNGA-INI ICT DIGITAL HUB.

Job no NG CDF-NT/M/ICTDH/11-26	**Scale** AS INDICATED
Date NOVEMBER 2026	**Total Square Metres** 175.58M²
Design by & Drawn by	HARRISON GICHUKI MWAI CLERK OF WORKS NG CDF- NYERI TOWN
Checked & Approved by:	

MINISTRY OF PUBLIC WORKS, HOUSING & URBAN DEVELOPMENT.
STATE DEPARTMENT FOR PUBLIC WORKS.
COUNTY WORKS OFFICER, NYERI.
P.O.BOX 572 - 10100,
NYERI

S

Building Section

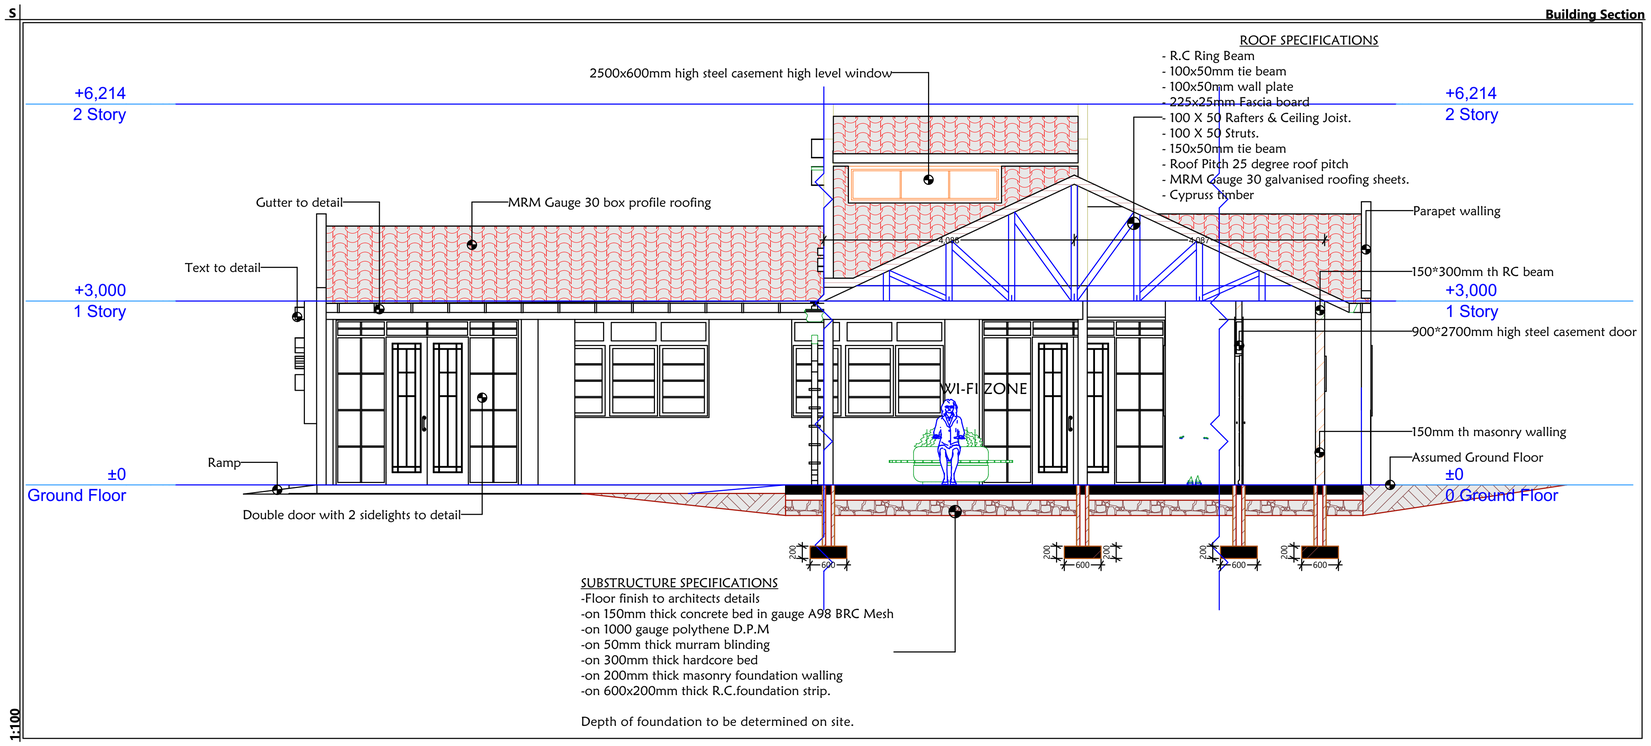

1:100

3

WINDOW SCHEDULE (2)

Window Schedule

Element ID	WINDOW 01	WINDOW 02	WINDOW 03	WINDOW 04	WINDOW 05	WINDOW 06	WINDOW 07
Quantity	2	12	1	3	3	4	7
W x H Size	2,500×600	600×1,200	1,000×1,600	1,500×1,600	2,000×1,600	1,200×1,600	2,500×1,600
Sill height	4,600	1,500	1,100	1,100	1,100	1,100	1,100
Head height	5,200	2,700	2,700	2,700	2,700	2,700	2,700
2D Symbol	2,500	600	1,000	1,500	2,000	1,200	2,500
View from Side Op...	2,500 × 600	600 × 1,200	1,000 × 1,600	1,500 × 1,600	2,000 × 1,600	1,200 × 1,600	2,500 × 1,600

1:100

11

DOOR SCHEDULE (3)

Door Schedule

Element ID	DOO - 005	DOO - 005	DOO - 013	DOO - 014
Opening Name	Double Door with 2 Sidelights, Transom	Double Door with Transom	Door with Transom	Door 27
Quantity	3	1	6	3
W x H Size	3,000×2,700	1,200×2,700	900×2,700	900×2,100
Head height	2,700	2,700	2,700	2,100
2D Symbol	3,000	1,200	900	900
View from Side Opposite to Opening Side	3,000 × 2,700	1,200 × 2,700	900 × 2,700	900 × 2,100

1:100

Generic Perspective (4)

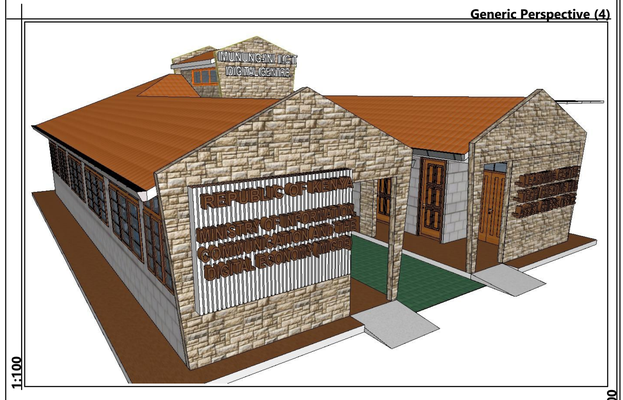

1:100

15

Roof Plan (7)

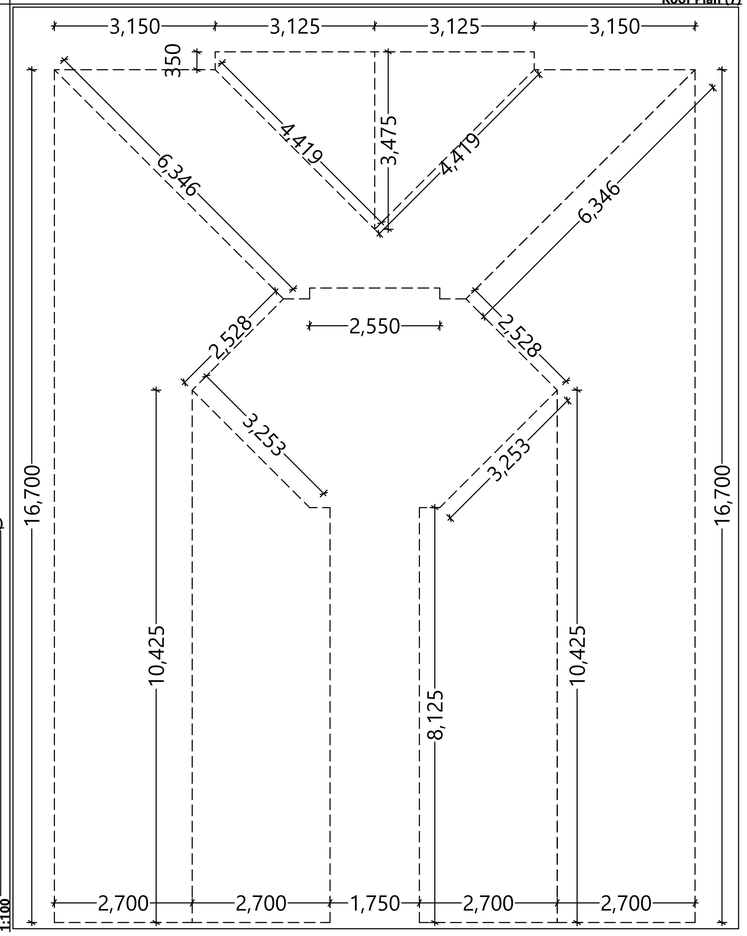

1:100

NOTES

1. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE STATED
2. THE STRUCTURAL DRAWING S SHALL BE READ IN CONJUCTION WITH ARCHITECTURAL DRAWINGS, AND IN THE EVENT OF ANY DESCREPANCIES, THE ENGINEER AND THE ARCHITECT SHALL BE NOTIFIED BEFORE PROCEEDING WITH THE WORK.
3. ALL DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR AND DRAWINGS SHALL NOT BE SCALED OFF. ONLY FIGURED DIMENSIONS SHALL BE USED.
4. CONCRETE SHALL HAVE 20 MM MAXIMUM SIZE OF AGGREGATES AND SHALL BE ADEQUATELY VIBRATED.
5. BLINDING CONCRETE SHALL BE CLASS 10/20 (1:4:8) MIX AND SHALL BE 50 MM THICK UNLESS OTHERWISE STAT E D.
6. BUILDING BLOCKS SHALL BE ADEQUATELY BONDED AND SET IN 1:3 CEMENT/SAND MORTAR.
7. STEEL REINFORCEMENT SHALL BE COLD WORKED BARS TO B.S. 4449 REF.
8. CONCRETE COVERS SHALL BE AS FOLLOWS :-
   - 50 MM FOR FOUNDATIONS
   - 40 MM FOR COLUMNS
   - 20 MM FOR SLABS AND STAIR-CASES
   - 25 MM FOR BEAMS
9. THE CONTRACTOR SHALL VERIFY THE DIMENSIONS GIVEN IN THE BENDING SCHEDULES BEFORE CUTTING AND BENDIN G STEEL REINFORCEMENT.
10. THESE NOTES DO NOT SUPERCEED THE SPECIFICATIONS AND THE CONTRACTOR SHALL CONSULT THE ENGINEER IN EVENT OF ANY CONTRADICTIONS.
11. ALL LOAD BEARING MASONRY WALLS, TO BE OF GOOD BUILDING STONE TO THE ENGINEER`S SATISFACTION JOINTED IN 1:3 MORTAR WITH A MINIMUM CRUSHING STRENGH OF 10 N/MM AND.
12. GRID SETTING TO BE CHECKED AND APPROVED BY THE ENGINEER.
13. FOUNDATION LEVEL TO BE SET AS PER THE CIVIL WORKS DRAWINGS AND TO BE DETERMINED BY THE ENGINEER ON SITE.
14. NO STEPS TO BE ALLOWED IN THE FOUNDATION UNLESS SPECIFIED BY THE ENGINEER.
15. TIMBER TO BE WELL SEASONED GENERAL GRADE CYPRESS OR EQUIVALENT TO THE ENGINEERS APPROVAL.
16. MINIMUM LOAD BEARING CONCRETE BLOCKS STRENGTH > 7 N/mm²
17. H/BLOCKS STRENGTH MINIMUM 13 KN/MM²

APPROVALS

CLIENT

NATIONAL GOVERNMENT CONSTITUENCIES DEVELOPMENT FUND - NYERI TOWN

DRAWING TITTLE

ROOF PLAN, SECTION, WINDOW AND DOOR SCHEDULE

PROJECT TITLE ·

PROPOSED CONSTRUCTION OF MUNUNGA-INI ICT DIGITAL HUB.

Job no NG CDF-NT/M/ICTDH/11-26	Scale AS INDICATED
Date NOVEMBER 2026	Total Square Metres 175.58M²
Design by & Drawn by	HARRISON GICHUKI MWAI CLERK OF WORKS NG CDF- NYERI TOWN

Checked & Approved by:

MINISTRY OF PUBLIC WORKS, HOUSING & URBAN DEVELOPMENT.
STATE DEPARTMENT FOR PUBLIC WORKS
COUNTY WORKS OFFICER, NYERI.
P.O.BOX 572 - 10100, NYERI